


HVAC PIPING REVISIONS PART-PLAN
SCALE: 1/8"=1'-0"

NOTES:

- ① REMOVE EXIST. HWS/HWR PIPING AT THIS POINT (X) & RECONNECT NEW PIPING REROUTED AROUND NEW CEILING POP-UP AS SHOWN.
- ② REINSTALL EXISTING FLOW STATION VALVES (RELOCATED), IN NEW 1 1/2" LINE AS SHOWN RECONNECT ALL CONTROLS TO EXISTING AS REQUIRED.
- ③ CONTRACTOR TO VISIT SITE TO VERIFY EXACT SIZES AND LOCATIONS OF EXISTING EQUIPMENT & PIPING.

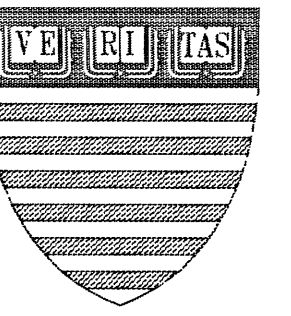

**KENNEDY
SCHOOL of
GOVERNMENT**

**HARVARD
UNIVERSITY**

**CSIA
RENOVATION**

PHASE 2

SCALE: 1/8" = 1' - 0"

JOB NO: 4769-96

DRAWN: B.S.K.

DATE: 10/28/96

FILE NAME: G:\769

REVISIONS: 2/5/97

PARTIAL THIRD
FLOOR PLAN
PIPING

TAKIP Consulting
Engineers Inc.
52 Temple Place Boston, Massachusetts 02111 TEL: (617) 552-0060 FAX: (617) 552-0188 © 1997 TAKIP CONSULTING ENGINEERS

ARCHITECTURAL
RESOURCES
CAMBRIDGE INC
140 MOUNT AUBURN ST
CAMBRIDGE MA 02138
TEL. (617) 547-2200
FAX. (617) 547-7222

M1-2